

# EL Summary Report


Serial Number 010056225  
 Logger Name S1 Pukuhuone

First Reading 19:57:06 7.3.2019  
 Last Reading 14:54:06 8.3.2019  
 Elapsed Time 18h, 57m  
 Total Readings 1138

Alarm *Not Set*  
 Logging Rate 1 Minute

Celsius	Low Alarm	<i>Not Set</i>	High Alarm	<i>Not Set</i>
Minimum <b>16,0°C</b> 19:57:06 7.3.2019	Alarm Occurrences	●	Alarm Occurrences	●
Maximum <b>22,0°C</b> 14:18:06 8.3.2019	N/A		N/A	
Average Reading	Total time in alarm		Total time in alarm	
<b>17,29°C</b>	N/A		N/A	
Mean Kinetic Temperature	First Alarm Triggered		First Alarm Triggered	
<b>17,28°C</b> ( $\Delta H83,14472$ )	N/A		N/A	
Standard Deviation	Longest Alarm		Longest Alarm	
<b>2,01°C</b>	N/A		N/A	

S1 Pukuhuone

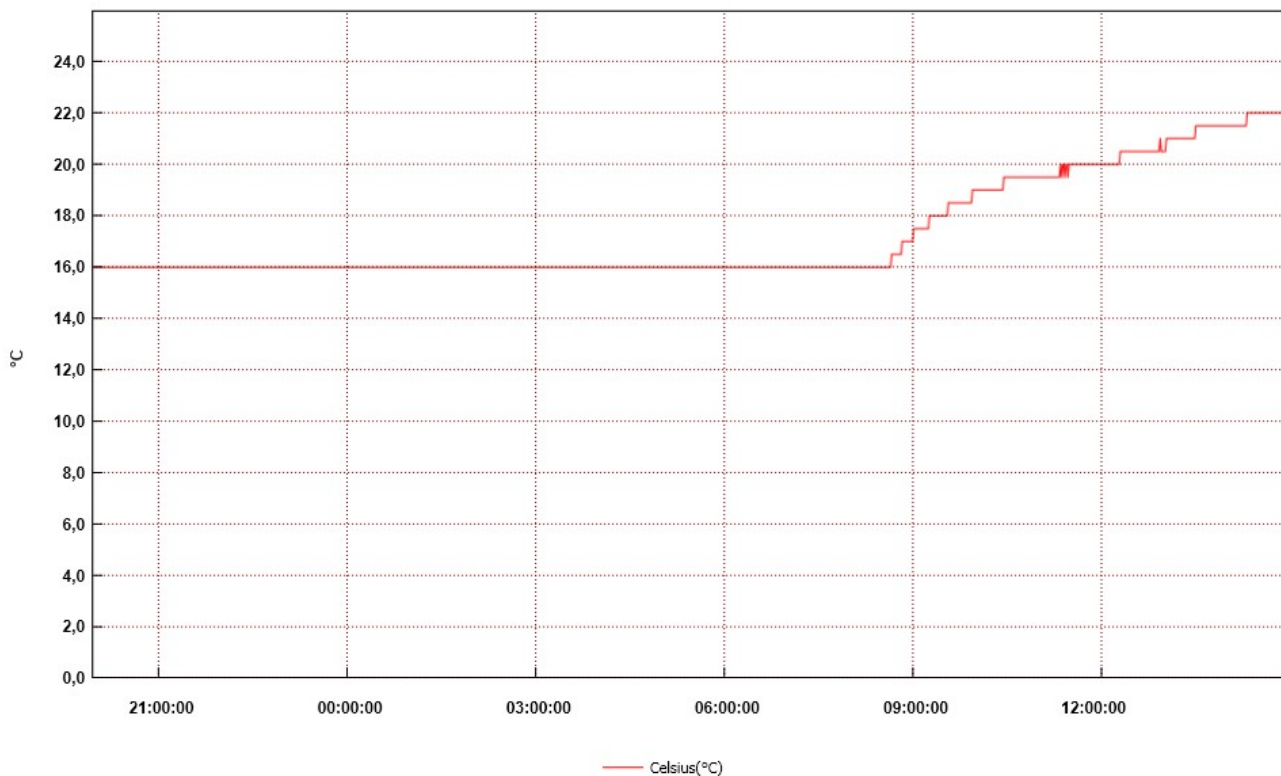

From: 7. maaliskuuta 2019 19:56:21 - To: 8. maaliskuuta 2019 14:54:20